


## NON-METALLIC PIPE


N.T.S.

2.5"-6" PIPE: 3" TAPE IS CENTERED  
ALONG TOP HALF OF PIPE


TYPICAL METALLIC PIPE

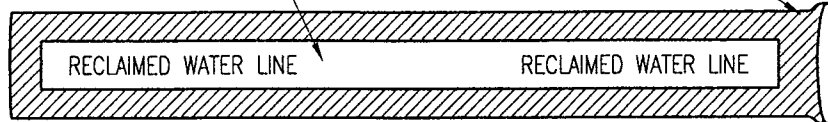

8"-18" PIPE: 6" TAPE IS PLACED ALONG  
BOTH SIDES OF TOP HALF OF PIPE

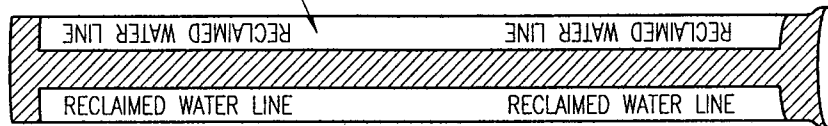


20" AND LARGER PIPE: TAPE IS PLACED ON BOTH  
SIDES OF THE TOP HALF OF THE PIPE WITH A THIRD  
STRIP CENTERED ALONG TOP HALF OF PIPE

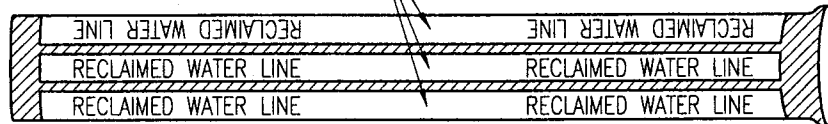

## METALLIC PIPE

N.T.S.

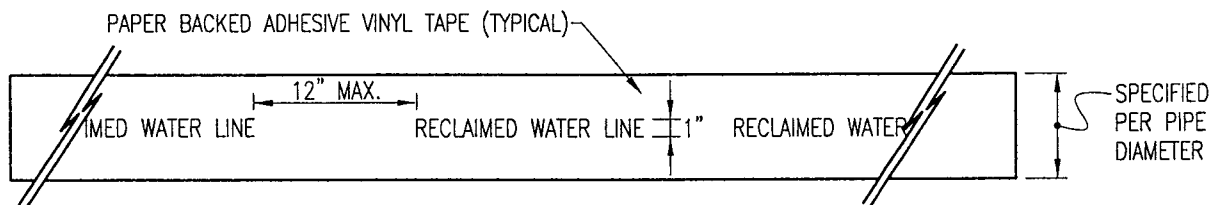

## PLAN VIEW

N.T.S.

### NOTES:

1. PIPE IDENTIFICATION: RECLAIMED WATER MAIN OR RECLAIMED WATER LINE.
2. THE LETTERING SHALL APPEAR ON A MINIMUM OF 3 SIDES OF THE PIPE AND SHALL RUN THE ENTIRE LENGTH OF THE PIPE.
3. LETTERING SHALL BE A MINIMUM OF  $\frac{3}{4}$ " HIGH AND SHALL APPEAR AT INTERVALS NOT LESS THAN ONCE EVERY 21 INCHES, LETTERING SHALL RUN THE ENTIRE LENGTH OF THE PIPE.
4. LETTERING SHALL BE PERMANENTLY IMPREGNATED INTO THE PVC WITH INDELIBLE INK DURING THE PIPE MANUFACTURING PROCESS. STENCILING ON THE PIPE SURFACE IS STRICTLY PROHIBITED.
5. TAPE SHALL RUN FROM JOINT TO JOINT ALONG THE ENTIRE LENGTH OF THE PIPE.
6. PIPE IDENTIFICATION LETTERING SHALL BE AS DESCRIBED ABOVE.
7. TAPE SHALL BE PURPLE PANTONE 522C WITH BLACK LETTERING.

ITEM	CROSS REF.	SPEC. REF.